

Peppers Cable Glands Limited

Stanhope Road, Camberley, Surrey, GU15 3BT United Kingdom
 Telephone: +44 (0) 1276 64232
 Facsimile: +44 (0) 1276 691752
 Email: sales@peppers.co.uk



Barrier Gland:- Type CR-S for Conduits




Including type No's:

C	R	S	*
		B	
		S	

Croclock CR-S type glands provide Flameproof EExd compound filled barrier seal on the cables individual conductors within a conduit. It also provides an entry thread seal. Croclock CR-S type glands maintain EExd Flameproof method of explosion protection; IP66, 68 to 100 metres and is deluge resistant.

COMPLIANCE STANDARD	EN 60079-0, EN 60079-1, EN 61241-0, EN 61241-1, IEC 60079-0, IEC 60079-1, IEC 61241-0 & IEC 61241-1														
CERTIFICATION	ATEX I M2 II 2 GD, E Exd I & IIC GOST R-Exd I & IIC CSA Exd I & IIC 4X IECEx Exd IIC / Exd I NEPSI Exd IIC / Exe II														
CERTIFICATE	SIRA 03ATEX1479X - Ex Notified Body No. 0518 POCC GB 06.B00420 CSA 1356011 IECEx SIR 07.0098X NEPSI GYJ06188X														
GLAND MARKING (EXAMPLE)	Peppers GU15 3BT UK CR-SB20/M20/M20 CA IEC Ex SIR 07.0098X Exd I & IIC/Ex tD A21 IP68 ГБ06 Sira 03ATEX1479X Ex I M2 II 2 GD EExd I & IIC														
APPLICATION	EExd Equipment CR-S type glands will maintain Flameproof Exd integrity. Ref: IEC60079-14:2002 Section 10.4.2 <table border="1"> <thead> <tr> <th>Gas Group</th> <th>Internal Ignition Source</th> <th>Enclosure Volume</th> <th>Which Zone</th> <th>Use CR-S Gland</th> </tr> </thead> <tbody> <tr> <td>I, IIC, IIB, IIA</td> <td>YES</td> <td>Any</td> <td>Zone 1 or 2</td> <td>YES</td> </tr> </tbody> </table> Other Equipment Mining Equipment Group I, M2 Ignitable Dust, Zones 21 and 22					Gas Group	Internal Ignition Source	Enclosure Volume	Which Zone	Use CR-S Gland	I, IIC, IIB, IIA	YES	Any	Zone 1 or 2	YES
Gas Group	Internal Ignition Source	Enclosure Volume	Which Zone	Use CR-S Gland											
I, IIC, IIB, IIA	YES	Any	Zone 1 or 2	YES											
INGRESS PROTECTION	IP66 & IP68 @ 100 metres, Enclosure Type 4X Meets the requirements of DTS01 1991														
CURING TIME	@ 21°C Conductor termination can be effected after 1 hour The equipment can be energised after 4 hours The compound chamber can be inspected after 4 hours														
MATERIALS	Brass CZ121 (CR-SB) 316 Stainless Steel (CR-SS) Inner LSOH compound Entry thread seal: Red LSOH silicone														
OPTIONS	THREADS	ISO Metric; NPT; NPS; ISO Pipe Thread (BSP Taper, BSP Parallel)													
	PLATING	Zinc (ZP); Nickel (NP); Tin (TP); Electroless Nickel (EN)													
OPERATING TEMPERATURES	-60°C to +85°C														
ACCESSORIES	Locknut - Brass (ACBLN); 316 Stainless Steel (ACSLN) Earth Tag - Brass (ACBET), 316 Stainless Steel (ACSET) IP Washer - Nylon (ACNSW); Red Fibre (ACFSW) Serrated Lock Washer - 316 Stainless Steel (ACSSW), Galvanised Steel (ACGSW)														

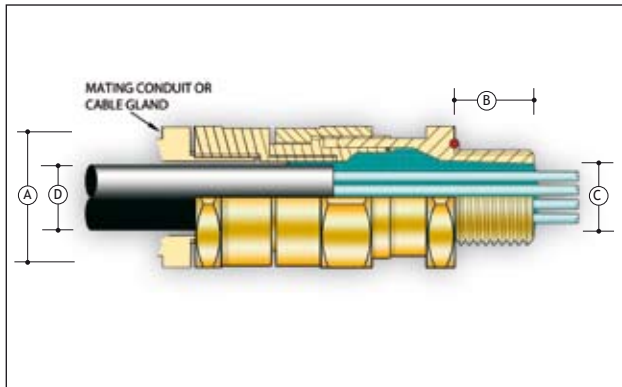

EXAMPLE PART NUMBER	<p>Sample: CR-SB 20 /NP /M20 /M20</p> <p>CR-S:</p> <p>CR-S - Gland type</p> <p>**.*B - Material (Brass)</p> <p>20 - Fitting size = 20</p> <p>NP - Nickel plating</p> <p>M20 - Male entry thread</p> <p>M20 - Female thread for gland or conduit entry</p>
---------------------	-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Fitting Size Ref	Male Entry Threads		Female Entry Threads		Entry Thread Length [B]	Max Across Corners [A]	Max Protrusion Length	Sealing Range Cable Conductors / Cores		
	Metric	NPT	Metric	NPT				Max No. of Cores	Max Over Cores [C]	Max Cable Inside Fitting [D]
20	M20	1/2" or 3/4"	M20	1/2" or 3/4"	16	33.0	57.0	14	12.5	14.0
25	M25	3/4" or 1"	M25	3/4" or 1"	16	41.4	63.0	25	17.8	20.0
32	M32	1" or 1 1/4"	M32	1" or 1 1/4"	16	50.6	67.0	50	23.5	26.3
40	M40	1 1/4" or 1 1/2"	M40	1 1/4" or 1 1/2"	16	60.5	68.0	80	28.8	32.2
50	M50	2"	M50	2"	16	71.5	68.0	100	39.4	44.1
63	M63	2 1/2"	M63	2 1/2"	19	88.0	72.0	120	50.0	56.0
75	M75	3"	M75	3"	19	99.0	78.0	140	60.8	68.0
80	M80 x 2	3" or 3 1/2"	M80 x 2	3" or 3 1/2"	25	115.2	103.0	160	64.4	72.0
85	M85 x 2	3" or 3 1/2"	M85 x 2	3" or 3 1/2"	25	115.2	103.0	180	69.8	78.0
90	M90 x 2	3 1/2" or 4"	M90 x 2	3 1/2" or 4"	25	125.7	104.0	200	75.1	84.0
100	M100 x 2	3 1/2" or 4"	M100 x 2	3 1/2" or 4"	25	125.7	104.0	220	80.5	90.0

All Dimensions are in mm

NOTES:

- Please note that dimensions (A) & (B) may differ for glands with non-Metric entry threads. Please refer to our thread data tables for specific dimensions
- Integral entry thread seal option is not available for glands with tapered entry threads. IP washers can be supplied if required
- Unless otherwise stated ISO Metric entry threads have a 1.5mm pitch
- For Flameproof Exd applications the female thread into which the gland is to be fitted must comply with clause 5.3 of EN 50018:2000 (clause 5.3 IEC 79-1) and an engagement of at least 5 full threads must be achieved for parallel threads and should be achieved for tapered threads
- If CR-S type glands are fitted into non-metallic enclosures they must be included within the earth circuit of the system
- The user should seek expert advice if intending to combine flammable gases and combustible dusts in one environment/installation
- To maintain ingress protection a thread sealant should be applied to the conduit thread
- Full assembly instructions are supplied with glands, the instructions must be read prior to installation and adhered to in full
- In order to maintain an IP rating greater than IP54, when used in a clearance hole, a suitable IP washer is required.
- Peppers supplies cable glands with parallel entry threads which conform to the flameproof threaded joint requirements of IEC 60079-1 and other equivalent standards. They usually incorporate a thread run out according to the available machining techniques, and will not have a full-form thread for the entire length. Peppers will not be held responsible for clients' installations where this has not been taken into account.

<http://www.cableglands.com>